

Victaulic Installation-Ready™ Rubber-Lined Butterfly Valve with Aluminum Bronze Disc



08.32

Series 122



Series 122

1.0 PRODUCT DESCRIPTION

Available Sizes

- 2 – 8"/DN50 – DN200

Pipe Material

- Designed for use on metallic pipe which features ends formed with the Victaulic Original Groove System (OGS) groove profile (see section 7.0 for Reference Materials)

End Preparation

- Victaulic Original Groove System (OGS)

Maximum Working Pressure

- 232 psi/1600 kPa/16 bar
- Full working pressure for bi-directional service

Operating Temperature

- Dependent on seat selection from section 3.0

Application

- Installation-Ready™ rubber-lined butterfly valve typically for use in commercial and industrial water applications
 - HVAC (Hot and cold water)
 - Process water

ALWAYS REFER TO ANY NOTIFICATIONS AT THE END OF THIS DOCUMENT REGARDING PRODUCT INSTALLATION, MAINTENANCE OR SUPPORT.



1.0 PRODUCT DESCRIPTION (CONTINUED)

Actuation Options

- Standard ISO 5211 mounting flange
 - 10-position lever lock handle, padlockable
 - Gear operator
 - Accommodates 2"/50 mm of insulation
-

2.0 CERTIFICATION/LISTINGS



Compliant with Closure/Seat Leakage Rate A per EN 12266-1, EN 1074-1, EN 1074-2 and ISO 5208

Product designed and manufactured under the Victaulic Quality Management System, as certified by LPCB in accordance with ISO-9001.

3.0 SPECIFICATIONS – MATERIAL

Housing: Ductile iron conforming to ASTM A536 Grade 65-45-12.

Housing Coating: (specify choice)

- Standard: Orange enamel.
- Optional: Hot dipped galvanized.
- Optional: Sherardized diffused zinc coating conforming to ISO 17668.

Body: Ductile iron conforming to ASTM A536 Grade 65-45-12.

Body Coating: (specify choice)

- Standard: Black enamel.
- Optional: Hot dipped galvanized.
- Optional: Sherardized diffused zinc coating conforming to ISO 17668.

Seat: Victaulic EPDM

EPDM. (Light green stripe color code.) Temperature range -30°F to +194°F/-34°C to +90°C. NOT RECOMMENDED FOR PETROLEUM SERVICES OR STEAM SERVICES.

NOTE

- Low temperature use is dependent upon system operating characteristics. Contact Victaulic for additional information on low temperature applications.

Bolts/Nuts: Carbon steel oval neck track bolts meeting the mechanical property requirements of ISO 898-1 Class 9.8 (M10-M16) Class 8.8 (M20 and greater). Carbon steel hex nuts meeting the mechanical property requirements of ASTM A563M Class 9 (metric - hex nuts). Track bolts and hex nuts are zinc electroplated per ASTM B633 FE/ZN5, finish Type II (metric).

3.0 SPECIFICATIONS – MATERIAL (CONTINUED)

Disc: Aluminum bronze conforming to C95500.

Shaft: AISI 416 stainless steel.

10-Position Lever Lock Handle:

- Ductile iron conforming to ASTM A536, Grade 65-45-12, with zinc-plated carbon steel latch plate and zinc-plated carbon steel fasteners.

Handle Coating: (specify choice)

- Standard: Black enamel.
- Optional: Hot dipped galvanized.
- Optional: Sherardized diffused zinc coating conforming to ISO 17668.

Gear Operator (with options below):


- Handwheel.
- Handwheel with chainwheel.

NOTE

- A padlockable valve refers to those valves which can be padlocked to lockout equipment for preventing inadvertent valve operation. When used in conjunction with an appropriate lockout/tagout system, multiple padlocks may be used. The valve may be padlocked either fully open or fully closed.

4.0 DIMENSIONS

Series 122 Installation-Ready™ Butterfly Valve – Bare Valve

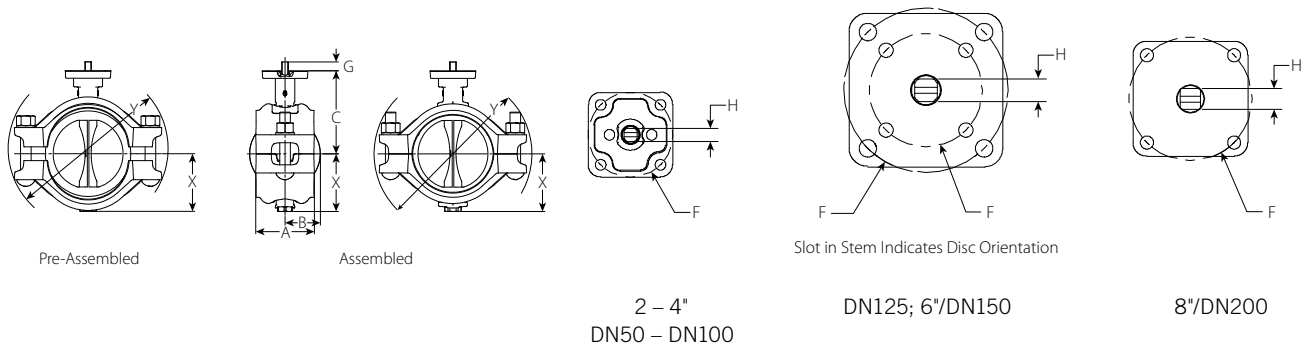


Size		Pipe End Separation	Bolt/Nut		Dimensions										Weight
Nominal inches DN	Actual Outside Diameter inches mm	Allowable inches mm	Qty.	Coupling Bolt Size mm	Pre-Assembled (Installation- Ready™ Condition)		Joint Assembled		A inches mm	B inches mm	C ¹ inches mm	F ISO 5211 Flange Designation	G inches mm	H (sq) inches mm	Approx. (Each) lb kg
					X inches mm	Y inches mm	X inches mm	Y inches mm							
2 DN50	2.375 60.3	1.99 51	2	M12 x 76	2.38 60	6.58 167	2.38 60	6.48 165	3.91 99	-	4.55 116	F07	0.64 16	0.35 9	7.4 3.4
2½	2.875 73.0	1.99 51	2	M12 x 76	2.58 66	6.99 178	2.58 66	6.98 177	3.91 99	-	4.75 120	F07	0.64 16	0.35 9	9.3 4.2
DN65	3.000 76.1	1.99 51	2	M12 x 76	2.64 67	7.29 185	2.64 67	7.18 182	3.91 99	-	4.81 122	F07	0.64 16	0.35 9	9.8 4.4
3 DN80	3.500 88.9	2.41 61	2	M16 x 83	3.06 78	9.07 230	3.06 78	8.91 226	4.31 109	2.18 55	5.17 131	F07	0.64 16	0.43 11	12.9 5.9
4 DN100	4.500 114.3	2.41 61	2	M16 x 83	3.54 90	10.23 260	3.54 90	10.10 257	4.35 110	2.20 56	5.67 144	F07	0.64 16	0.43 11	16.6 7.5
DN125	5.500 139.7	2.80 71	2	M20 x 108	4.27 109	11.97 304	4.27 109	11.71 297	4.73 120	2.46 63	6.37 162	F07 F10	0.79 20	0.55 14	26.6 12.1
6 DN150	6.625 168.3	2.82 72	2	M20 x 127	4.74 120	13.17 335	4.74 120	12.99 330	4.76 121	2.90 74	6.83 174	F07 F10	0.79 20	0.55 14	30.7 13.9
8 DN200	8.625 219.1	3.36 85	2	M22 x 140	6.23 158	15.51 394	6.23 158	15.44 392	5.73 146	3.76 96	7.93 201	F10	0.83 21	0.67 17	54.1 24.6

¹ For assemblies with the insulation extension kit (I-120.EXT):

- Add 2½"/63 mm to the "C" dimension.
- Add additional weight as follows:
 - 2" – 76.1 mm = 1.0 lb/0.5 kg
 - 3" – 4" = 1.3 lb/0.6 kg
 - 139.7 mm – 6" = 1.7 lb/0.8 kg
 - 8" = 2.0 lb/0.9 kg sw

4.1 DIMENSIONS

Series 122 Installation-Ready™ Butterfly Valve – With Handle

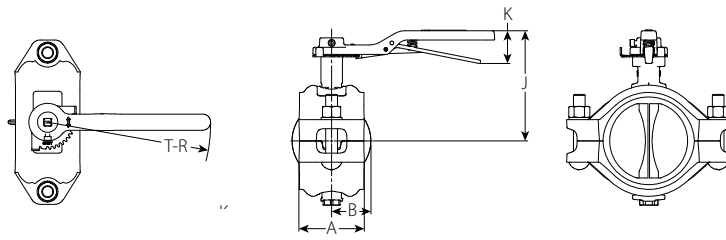


Size		Pipe End Separation	Bolt/Nut		Dimensions									Weight
Nominal inches DN	Actual Outside Diameter inches mm	Allowable inches mm	Qty.	Coupling Bolt Size mm	Pre-Assembled (Installation-Ready™ Condition)		Joint Assembled		A inches mm	B inches mm	T-R inches mm	J ² inches mm	K inches mm	Approx. (Each) lb kg
					X inches mm	Y inches mm	X inches mm	Y inches mm						
2 DN50	2.375 60.3	1.99 51	2	M12 x 76	2.38 60	6.58 167	2.38 60	6.48 165	3.91 99	–	7.00 178	6.00 152	1.93 49	8.1 3.7
2½	2.875 73.0	1.99 51	2	M12 x 76	2.58 66	6.99 178	2.58 66	6.98 177	3.91 99	–	7.00 178	6.20 157	1.93 49	9.9 4.5
DN65	3.000 76.1	1.99 51	2	M12 x 76	2.64 67	7.29 185	2.64 67	7.18 182	3.91 99	–	7.00 178	6.26 159	1.93 49	10.5 4.8
3 DN80	3.500 88.9	2.41 61	2	M16 x 83	3.06 78	9.07 230	3.06 78	8.91 226	4.31 109	2.18 55	9.00 229	6.37 162	2.22 56	14.3 6.5
4 DN100	4.500 114.3	2.41 61	2	M16 x 83	3.54 90	10.23 260	3.54 90	10.10 257	4.35 110	2.20 56	9.00 229	6.87 174	2.22 56	18.0 8.2
DN125	5.500 139.7	2.80 71	2	M20 x 108	4.27 109	11.97 304	4.27 109	11.71 297	4.73 120	2.46 63	12.00 305	7.72 196	2.42 61	28.1 12.8
6 DN150	6.625 168.3	2.82 72	2	M20 x 127	4.74 120	13.17 335	4.74 120	12.99 330	4.76 121	2.90 74	12.00 305	8.18 208	2.42 61	32.2 14.6
8 DN200	8.625 219.1	3.36 85	2	M22 x 140	6.23 158	15.51 394	6.23 158	15.44 392	5.73 146	3.76 96	14.00 356	9.53 242	2.72 69	55.9 25.4

² For assemblies with the insulation extension kit (I-120.EXT):

- Add 2 ½"/63 mm to the "J" dimension.
- Add additional weight as follows:
 - 2" – 76.1 mm = 1.0 lb/0.5 kg
 - 3" – 4" = 1.3 lb/0.6 kg
 - 139.7 mm – 6" = 1.7 lb/0.8 kg
 - 8" = 2.0 lb/0.9 kg

4.2 DIMENSIONS

Series 122 Installation-Ready™ Butterfly Valve – With Gear Operator

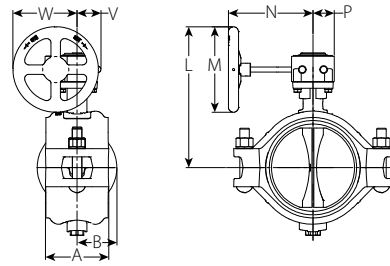

Size		Pipe End Separation	Bolt/Nut		Dimensions												Weight
Nominal inches DN	Actual Outside Diameter inches mm	Allowable inches mm	Qty.	Coupling Bolt Size mm	Pre-Assembled (Installation-Ready™ Condition)		Joint Assembled		A	B	L ³	M	N	P	V	W	Approx. (Each) lb kg
					X	Y	X	Y									
					inches mm	inches mm	inches mm	inches mm	inches mm	inches mm	inches mm	inches mm	inches mm	inches mm	inches mm	inches mm	
2 DN50	2.375 60.3	1.99 51	2	M12 x 76	2.38 60	6.58 167	2.38 60	6.48 165	3.91 99	-	7.52 191	3.94 100	5.16 131	1.65 42	1.89 48	3.68 93	9.9 4.5
2½ DN65	2.875 73.0	1.99 51	2	M12 x 76	2.58 66	6.99 178	2.58 66	6.98 177	3.91 99	-	7.72 196	3.94 100	5.16 131	1.65 42	1.89 48	3.68 93	12.2 5.5
3 DN80	3.000 76.1	1.99 51	2	M12 x 76	2.64 67	7.29 185	2.64 67	7.18 182	3.91 99	-	7.80 198	3.94 100	5.16 131	1.65 42	1.89 48	3.68 93	12.3 5.6
4 DN100	3.500 88.9	2.41 61	2	M16 x 83	3.06 78	9.07 230	3.06 78	8.91 226	4.31 109	2.18 55	8.14 207	3.94 100	5.16 131	1.65 42	1.89 48	3.68 93	15.2 6.9
6 DN125	4.500 114.3	2.41 61	2	M16 x 83	3.54 90	10.23 260	3.54 90	10.10 257	4.35 110	2.20 56	8.64 219	3.94 100	5.16 131	1.65 42	1.89 48	3.68 93	18.9 8.6
8 DN150	5.500 139.7	2.80 71	2	M20 x 108	4.27 109	11.97 304	4.27 109	11.71 297	4.73 120	2.46 63	10.00 254	4.92 125	6.89 175	2.20 56	2.24 57	4.53 115	29.9 13.6
10 DN200	6.625 168.3	2.82 72	2	M20 x 127	4.74 120	13.17 335	4.74 120	12.99 330	4.76 121	2.90 74	10.47 266	4.92 125	6.89 175	2.20 56	2.24 57	4.53 115	34.0 15.4
12 DN250	8.625 219.1	3.36 85	2	M22 x 140	6.23 158	15.51 394	6.23 158	15.44 392	5.73 146	3.76 96	12.26 311	6.30 160	7.17 182	2.20 56	2.24 57	5.22 133	61.1 27.7

³ For assemblies with the insulation extension kit (I-120.EXT):

- Add 2½"/63 mm to the "L" dimension.
- Add additional weight as follows:
 - 2" – 76.1 mm = 1.0 lb/0.5 kg
 - 3" – 4" = 1.3 lb/0.6 kg
 - 139.7 mm – 6" = 1.7 lb/0.8 kg
 - 8" = 2.0 lb/0.9 kg

4.3 DIMENSIONS

Accessories

Chainwheels


Chainwheels are mounted to the gear operator handwheels. Sprocket rim and guide arms are made of cast aluminum. Chain is galvanized steel weldless lock link chain.

HOW TO ORDER:

Specify type valve and operator by valve numbering system shown on page 10.

Always specify length of chain required.

For insulation and locking device, contact Victaulic for details. Handwheel input shaft extensions are not for use with chainwheels.

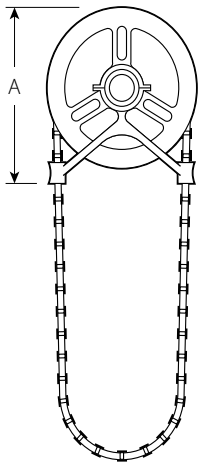

Chainwheel and Guide
with Safety Cable Kit

Size		Sprocket Size	Chain Trade Size	Chainwheel Size (Diameter)	Dimensions	Weight
Nominal inches DN	Actual Outside Diameter inches mm				A inches mm	Approximate (Each) lb kg
2 – 4 DN50 – DN100	2.375 – 4.500 60.3 – 114.3	0	2	4.00 102	4.63 118	2.00 0.9
DN125 – DN150	5.500 – 6.625 139.7 – 168.3	1	1/0	5.75 146	6.38 162	4.00 1.8
8 DN200	8.625 219.1	1 ½	1/0	7.50 190	7.75 197	5.00 2.3

5.0 PERFORMANCE

Series 122 Installation-Ready™ Butterfly Valve

Flow Characteristics

C_v/K_v values for flow of water at +60°F/+16°C with various disc positions are shown in the table below.

Formulas for C_v/K_v values:

$$\Delta P = \frac{Q^2}{C_v^2}$$

$$Q = C_v \times \sqrt{\Delta P}$$

Where:

Q = Flow (GPM)
 ΔP = Pressure Drop (psi)
 C_v = Flow Coefficient

$$\Delta P = \frac{Q^2}{K_v^2}$$







$$Q = K_v \times \sqrt{\Delta P}$$

Where:

Q = Flow (m³/hr)
 ΔP = Pressure Drop (Bar)
 K_v = Flow Coefficient

Size		Full Open C _v K _v
Nominal Size inches DN	Actual Outside Diameter inches mm	
2 DN50	2.375 60.3	149 128
2½	2.875 73.0	283 243
DN65	3.000 76.1	273 235
3 DN80	3.500 88.9	298 256
4 DN100	4.500 114.3	653 562
DN125	5.500 139.7	858 738
6 DN150	6.625 168.3	1667 1434
8 DN200	8.625 219.1	2695 2318

Flow Coefficients

Size		Flow Coefficients					
Nominal Size inches DN	Actual Outside Diameter inches mm	Degrees From Closed					
		90 	70 	60 	50 	40 	30 
		C _v K _v	C _v K _v	C _v K _v	C _v K _v	C _v K _v	C _v K _v
2 DN50	2.375 60.3	149 128	114 98	74 64	42 36	24 21	11 10
2½	2.875 73.0	283 243	190 163	112 96	63 54	37 32	18 16
DN65	3.000 76.1	273 235	216 186	138 118	76 65	43 37	22 19
3 DN80	3.500 88.9	298 256	183 158	112 97	64 55	36 31	23 20
4 DN100	4.500 114.3	653 562	383 329	238 204	134 116	69 59	32 28
DN125	5.500 139.7	858 738	585 503	366 314	216 186	117 101	53 45
6 DN150	6.625 168.3	1667 1434	1122 965	659 567	406 350	235 202	111 95
8 DN200	8.625 219.1	2695 2318	2007 1726	1349 1160	854 734	517 444	269 231

5.1 PERFORMANCE

Series 122 Installation-Ready™ Butterfly Valve

Torque Requirements

Size		Torque - Inch Pounds/Newton Meters				
Nominal inches DN	Actual Outside Diameter inches mm	Differential Pressure – psi/bar				
		50/3	100/7	150/10	200/14	232/16
2	2.375	52	64	75	87	94
DN50	60.3	6	7	8	10	11
2½	2.875	64	79	93	108	117
	73.0	7	9	11	12	13
DN65	3.000	86	100	114	128	137
	76.1	10	11	13	14	15
3	3.500	137	176	204	237	251
DN80	88.9	15	20	23	27	28
4	4.500	190	229	269	309	334
DN100	114.3	21	26	30	35	38
DN125	5.500	409	544	680	815	901
	139.7	46	62	77	92	102
6	6.625	542	663	782	904	982
DN150	168.3	61	75	88	102	111
8	8.625	862	982	1103	1224	1307
DN200	219.1	97	111	125	138	148

Source

These torque values were derived from test data with valves in water at ambient temperatures with EPDM seals. For other material and service conditions, apply a suitable service factor.

Torque Factors

All torque values are for normal conditions (i.e., the valve is operated at least once a quarter, disc corrosion is expected to be minor, the media is clean and nonabrasive, and the chemical effects upon the elastomer are minor).

Typical Fluid Torque Factors Commonly Used in the Industry

Water: 1.0; Lubricated service: 0.8.

Material Torque Factors

EPDM = 1.0

Cycling Factor

Valve torque will typically increase and actuator output decrease as the valve is cycled. A factor of 1.5 should be applied for when total valve cycles are expected to exceed 5,000.

Actuation Factor

A factor should be added to account for potential drift in the output of the actuator due to actuator performance, misalignment or external inputs (i.e., air or power supply). For this, a factor of up to 1.25 may be used.

Combining Torque Factors

When multiple torque factors apply, they are combined by multiplying them. Example: For an EPDM seal and a 5,000-cycle factor, the combined factor would be $1.0 \times (1.5) = 1.5$.

NOTES

- Under certain high flow conditions, the hydrodynamic torque can exceed the seating torque. Large butterfly valves are not recommended for use in a free discharge condition, such as filling an empty line with fluid or draining a system at the full-rated pressure.
- Contact Victaulic for other services.

5.2 PERFORMANCE

Series 122 Installation-Ready™ Butterfly Valve

V - 040 - 122 P E - 0

Type	Actual OD in/mm	Size Code	Series	Body	Seat	Operator
V	2.375/60.3	020	122	P - Painted	E - EPDM	0 - Bare
	2.875/73.0	024		G - Galvanized		2 - 10-Position lever lock handle
	3.000/76.1	761		D - Sherardized diffused zinc		3 - Gear operator with hand wheel
	3.500/88.9	030				6 - Gear operator with chain wheel
	4.500/114.3	040				
	5.500/139.7	139				
	6.625/168.3	060				
	8.625/219.1	080				

5.3 PERFORMANCE

Series 122 Installation-Ready™ Butterfly Valve

Important Installation Considerations

Always refer to the I-120 Installation and Gear Operator Conversion Manual for complete installation instructions.

When using the Series 122 Installation-Ready™ Butterfly Valve for throttling service, Victaulic recommends positioning the disc no less than 30 degrees open. For best results, the disc should be between 30 and 70 degrees open; this is dependent on the flow requirements/characteristics for the piping system. High pipeline velocities and/or throttling with the disc less than 30 degrees open may result in noise, vibration, cavitation, erosion, and/or loss of control. Contact Victaulic regarding throttling services.

Victaulic recommends limiting the flow velocities for water service to 13.5 feet/second (4 meters/second). Contact Victaulic before installing this valve when higher flow velocities are necessary or specified.






Victaulic recommends good piping practices and installing the valve five pipe diameters downstream of sources of irregular flow, such as pumps, elbows and control valves. If not practical due to space constraints, the system should be designed to locate and orient the valve to minimize the impact of dynamic torque and valve life.



Do not install butterfly valves into the system with the disc in the fully open position. Exposed disc may be damaged and prevent proper function of the valve.

6.0 NOTIFICATIONS

⚠ WARNING

- Read and understand all instructions before attempting to install any Victaulic piping products.
- Always depressurize and drain the piping system before attempting to install, remove, adjust, or maintain any Victaulic piping products.
- Wear safety glasses, hardhat, and foot protection.
- **DO NOT USE AN INSTALLATION-READY™ BUTTERFLY VALVE IN DEAD-END SERVICE OR FOR A SYSTEM LEAK TEST IN A DEAD-END SERVICE.**
- **ALWAYS VERIFY THAT MATING COMPONENTS WITH THE CORRECT GROOVE PROFILE ARE BEING USED WITH THE VALVE.**
- **DO NOT LOOSEN OR TIGHTEN HARDWARE WHEN THE VALVE IS PRESSURIZED.**
- The system designer is responsible for verifying suitability of mating component materials with the intended fluid media.
- The effect of chemical composition, pH level, operating temperature, chloride level, oxygen level, and flow rate on mating component materials shall be evaluated to confirm system life will be acceptable for the intended service.

Failure to follow these instructions could result in death or serious personal injury and property damage.

7.0 REFERENCE MATERIALS

[24.01: Victaulic Pipe Preparation Tools](#)

[I-120: Victaulic Installation and Operator Conversion Instructions](#)

User Responsibility for Product Selection and Suitability

Each user bears final responsibility for making a determination as to the suitability of Victaulic products for a particular end-use application, in accordance with industry standards and project specifications, and the applicable building codes and related regulations as well as Victaulic performance, maintenance, safety, and warning instructions. Nothing in this or any other document, nor any verbal recommendation, advice, or opinion from any Victaulic employee, shall be deemed to alter, vary, supersede, or waive any provision of Victaulic Company's standard conditions of sale, installation guide, or this disclaimer.

Intellectual Property Rights

No statement contained herein concerning a possible or suggested use of any material, product, service, or design is intended, or should be construed, to grant any license under any patent or other intellectual property right of Victaulic or any of its subsidiaries or affiliates covering such use or design, or as a recommendation for the use of such material, product, service, or design in the infringement of any patent or other intellectual property right. The terms "Patented" or "Patent Pending" refer to design or utility patents or patent applications for articles and/or methods of use in the United States and/or other countries.

Note

This product shall be manufactured by Victaulic or to Victaulic specifications. All products to be installed in accordance with current Victaulic installation/assembly instructions. Victaulic reserves the right to change product specifications, designs and standard equipment without notice and without incurring obligations.

Installation

Reference should always be made to the Victaulic installation handbook or installation instructions of the product you are installing. Handbooks are included with each shipment of Victaulic products, providing complete installation and assembly data, and are available in PDF format on our website at www.victaulic.com.

Warranty

Refer to the Warranty section of the current Price List or contact Victaulic for details.

Trademarks

Victaulic and all other Victaulic marks are the trademarks or registered trademarks of Victaulic Company, and/or its affiliated entities, in the U.S. and/or other countries.